



SAN-AI ETHYLENE CONTROL

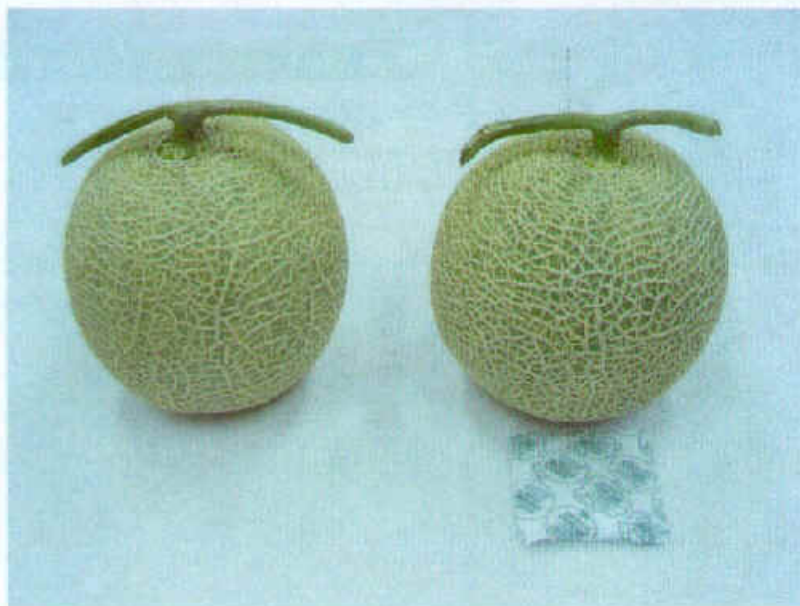

Ethylene Control test	
Commodity	Melcn (2)
Term	For 20 days
Room temp	27°C
Humidity	70%

1st day

Left	Right
Non ECI	With ECI

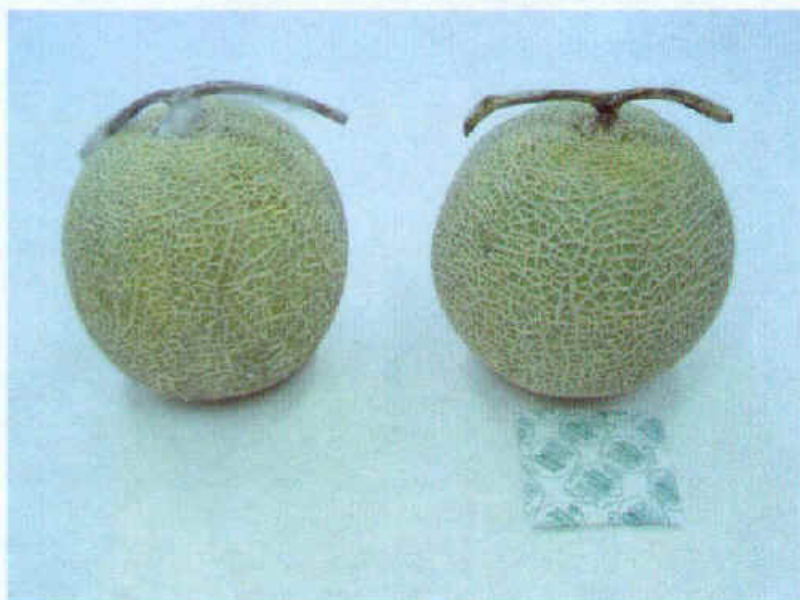

12 days after

Left	Right
Non ECI	With ECI



20 days after

Left	Right
Non ECI	With ECI